



Event sStipulation:

Food trucks must be separated by 10ft minimum hood system must be installed on any food truck where cooking is conducted. The hood suppression system must have a current tag by licensed Georgia fire suppression company. All food trucks must have ABC type extinguisher, food truck that use oil for cooking must have a class k extinguisher. All extinguishers must have a current tag from a licensed Georgia fire extinguisher company. All pressurized (propane.Co2) tanks must be secured. Generators must be 20ft from any structure and the public

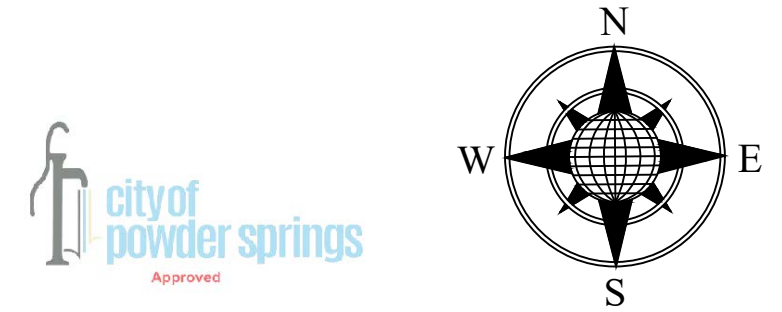

Approval Notes

1)ADA parking must include 5' aisle in the center of two spaces as detailed below.

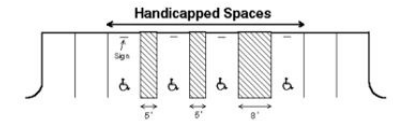


2)Restrooms must include handwashing station. Until a certificate of occupancy is issued for the new use of the building, use of the building is not permitted.

3)Storage for Food Trucks or grills must be marked by signage onsite and is limited to area shown in yellow on the site plan. Only Cobb County approved trucks or grills may be stored on the property. Personal grills are not permitted to be stored onsite.

4)Fire Marshal site approval is required and will indicate minimum spacing between food trucks in operation.

5)The maximum number of trucks allowed in operation on the site is 10. Parking spaces shown in area labeled Food truck parking on the site plan are standard parking spaces and do not indicate the layout of parking for food trucks.

6) Must meet all conditioins of approval dated April 3, 2023.

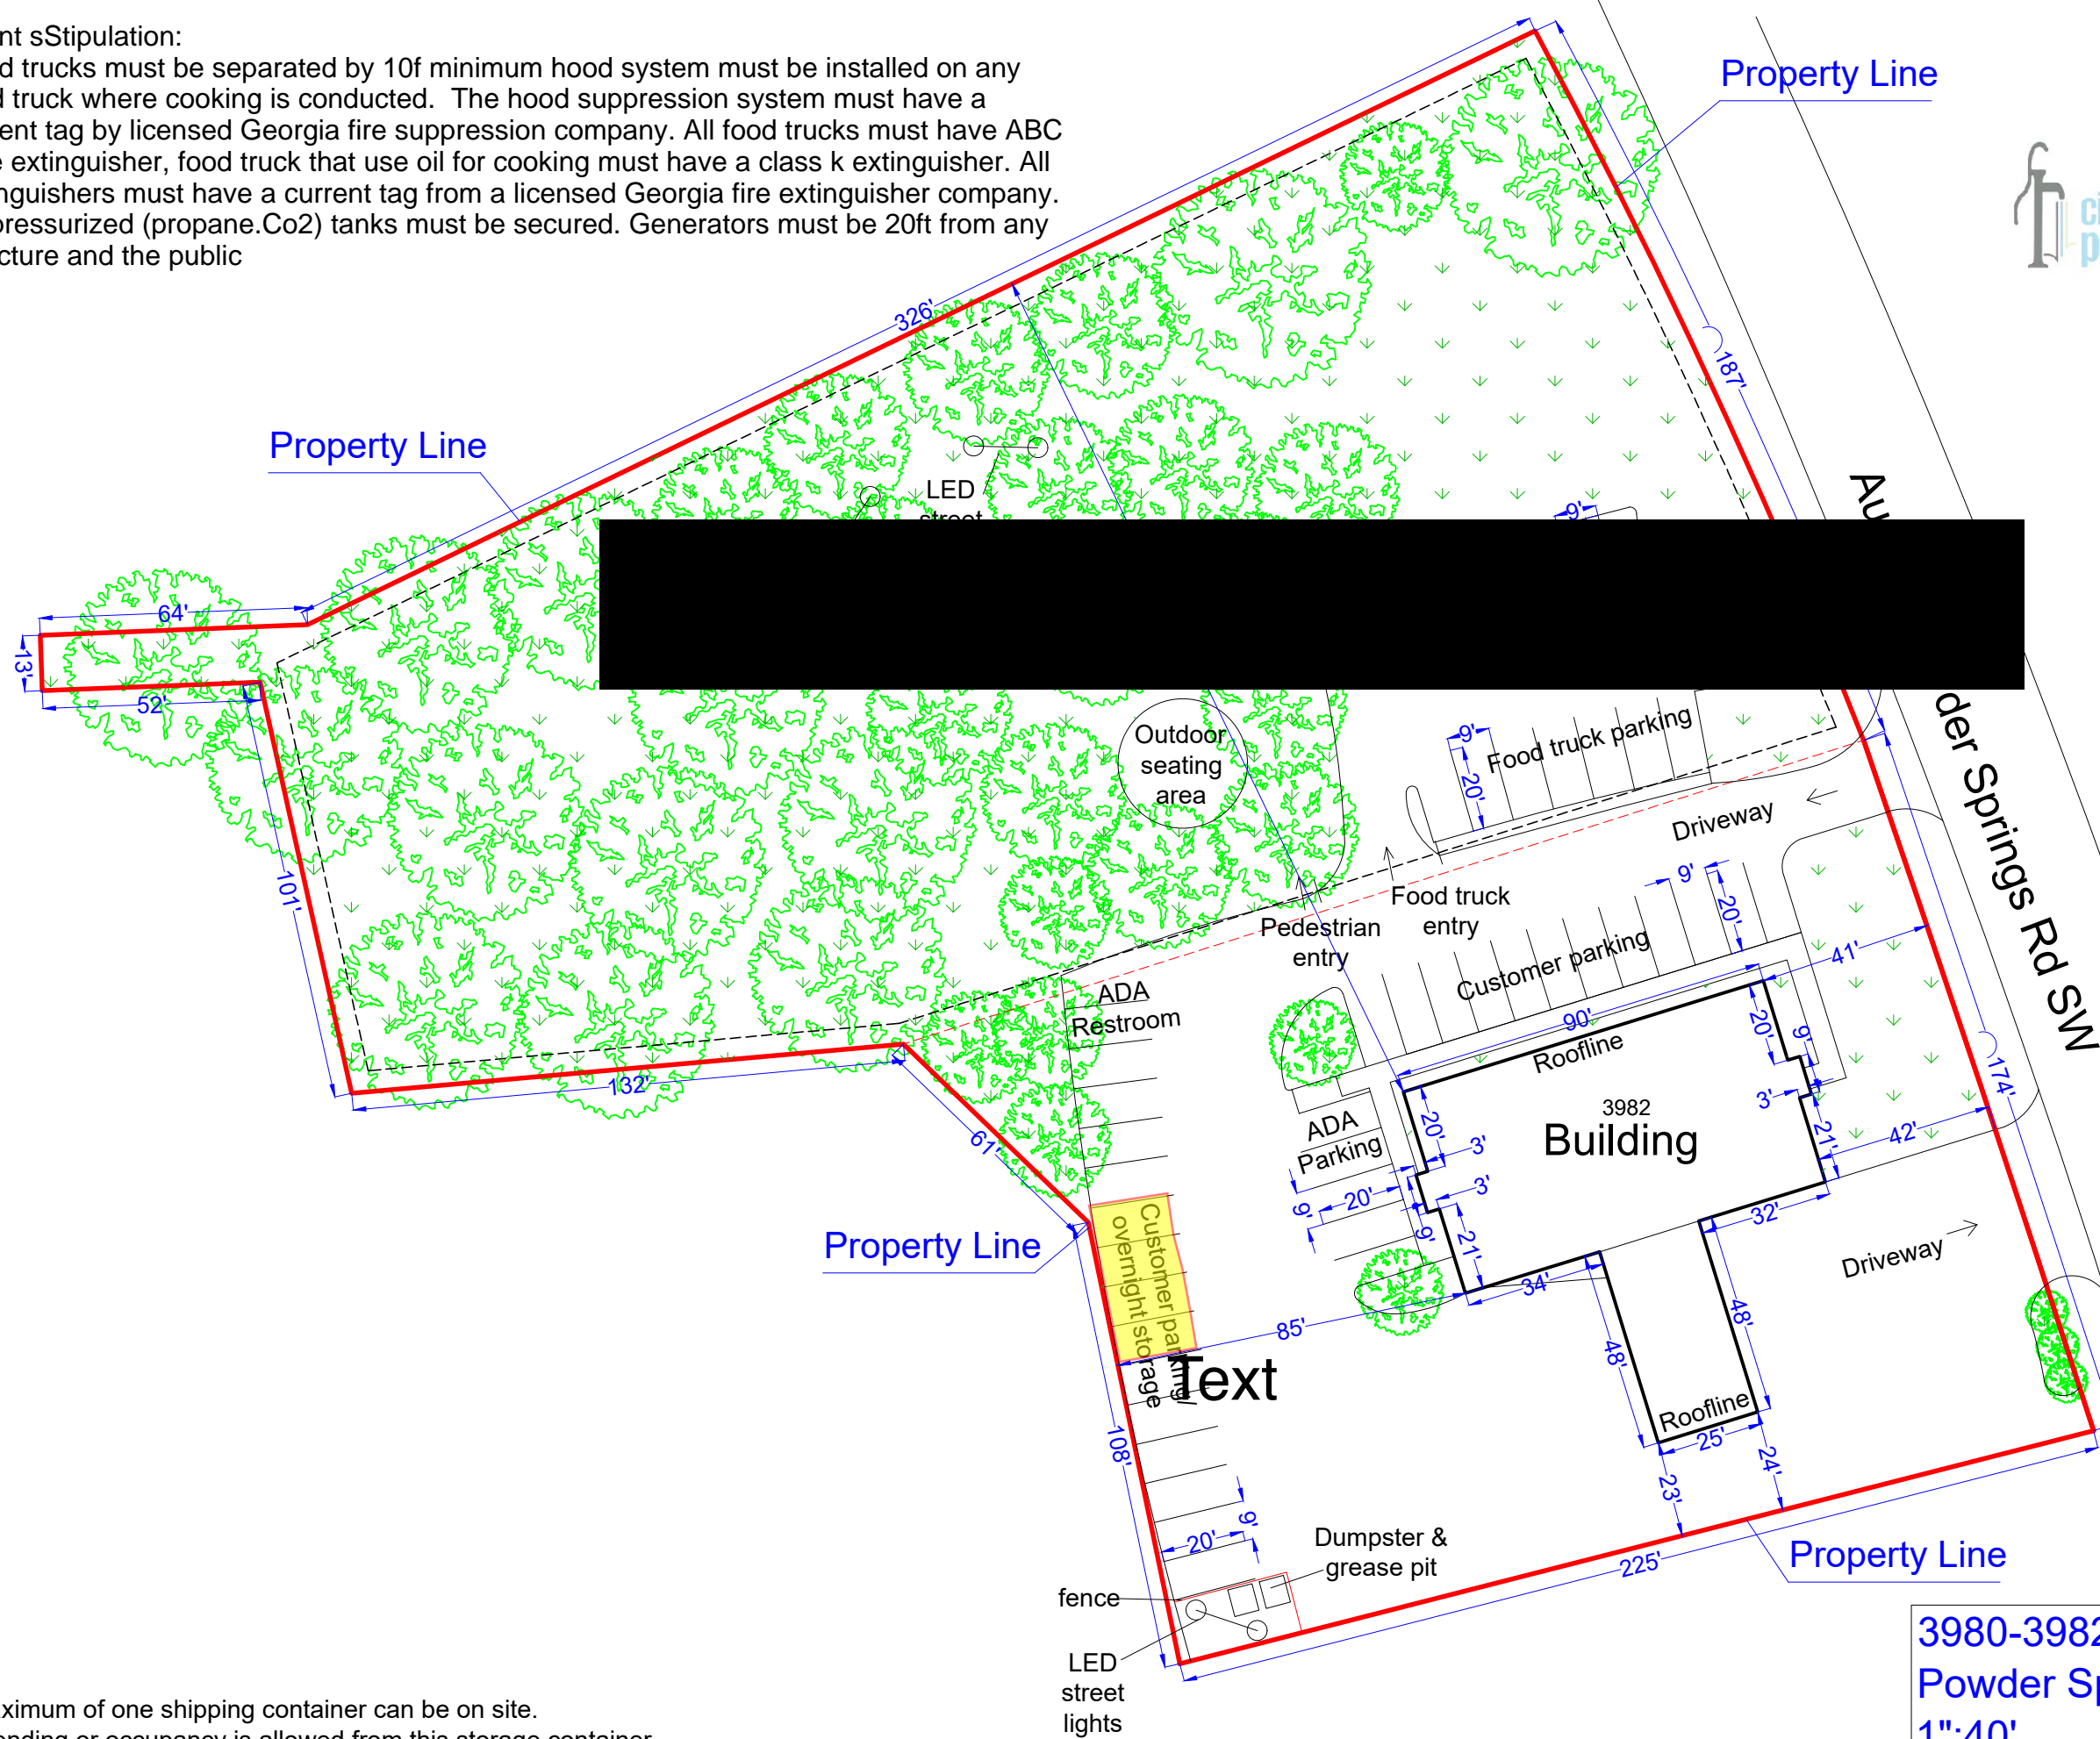

Note:
A maximum of one shipping container can be on site.
No vending or occupancy is allowed from this storage container.

**3980-3982 Austell Powder Springs Rd SW
Powder Springs, GA 30127
1":40'**