


Event stipulation:

Food trucks must be separated by 10f minimum hood system must be installed on any food truck where cooking is conducted. The hood suppression system must have a current tag by licensed Georgia fire suppression company. All food trucks must have AB type extinguisher, food truck that use oil for cooking must have a class k extinguisher. All extinguishers must have a current tag from a licensed Georgia fire extinguisher company. All pressurized (propane,Co2) tanks must be secured. Generators must be 20ft from any structure and the public



ADA parking must include 5' aisle in the center of two spaces as detailed below.

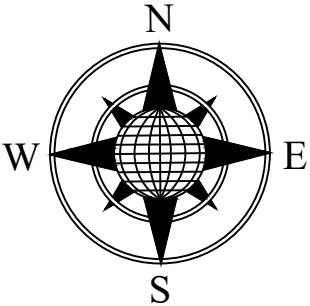


Only Cobb County approved trucks or grills may be stored on the property. Personal grills are not permitted to be stored onsite.

Fire Marshal site approval is required and will indicate minimum spacing between food trucks in operation.

The maximum number of trucks allowed in operation on the site is 5, subject to approval by EMO.

Must meet all conditions of approval

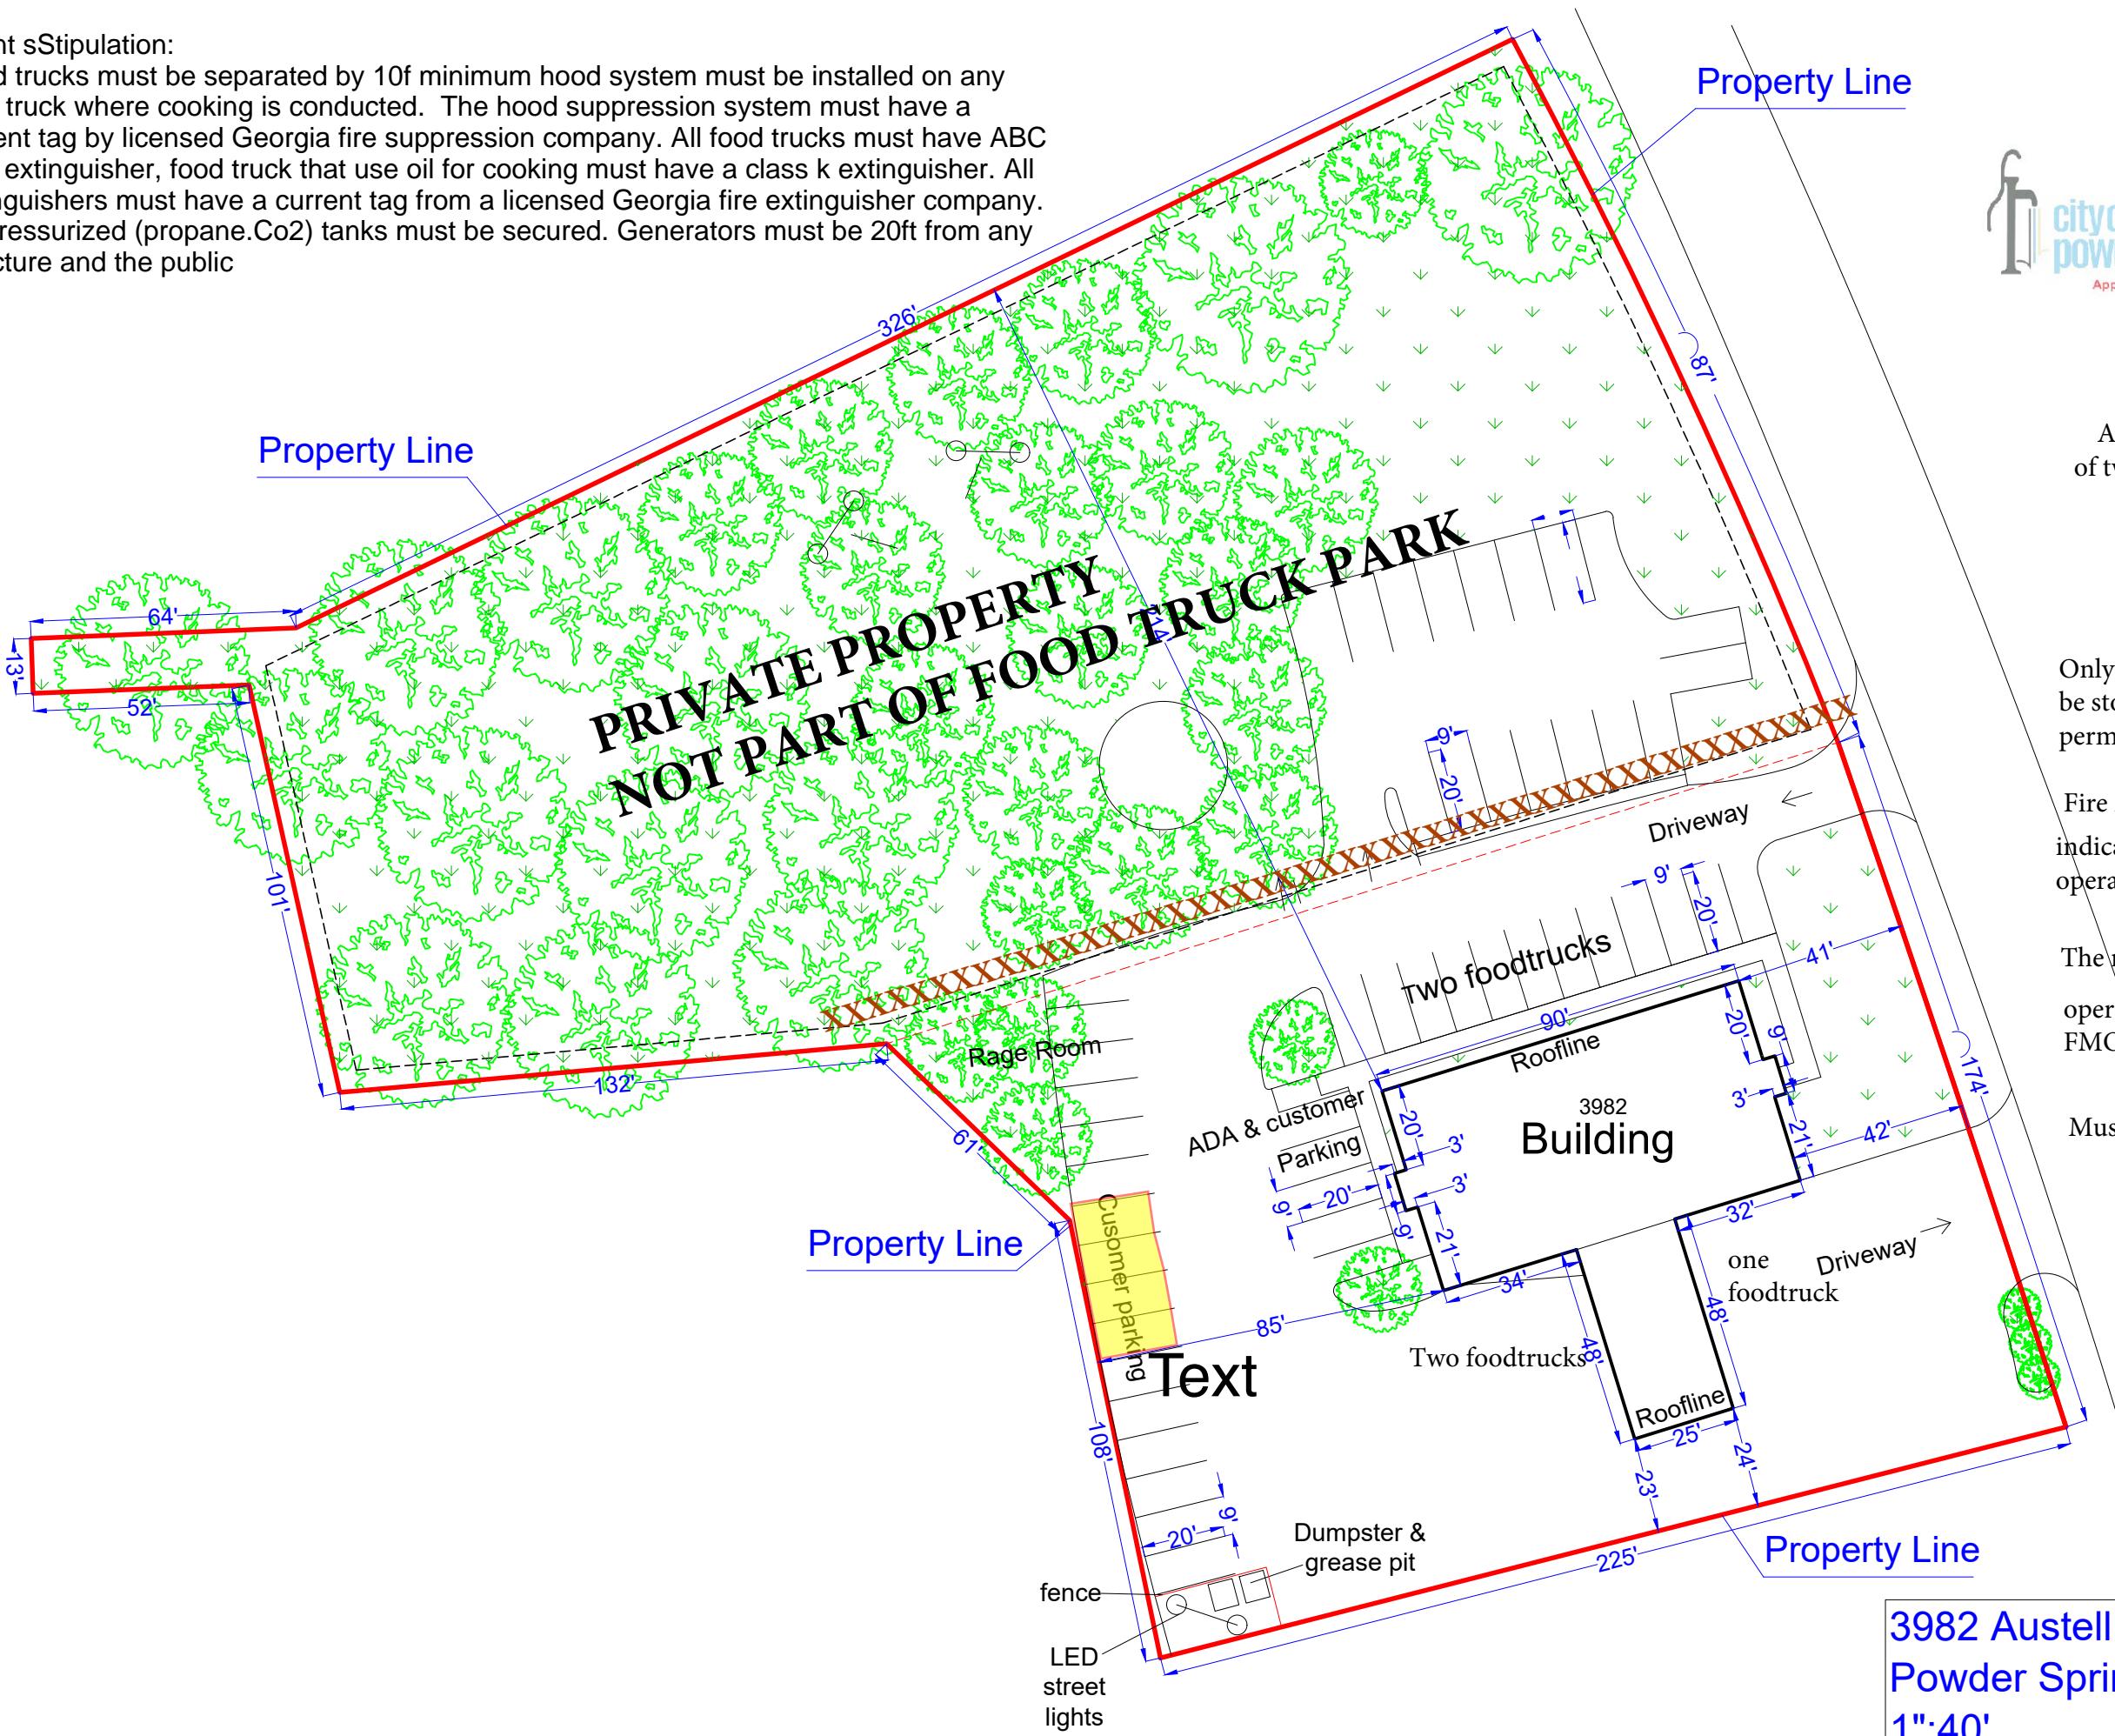

3982 Austell Powder Springs Rd SW
Powder Springs, GA 30127
1":40'